


FRAME AND GRATE SHALL BE EAST JORDAN IRON WORKS No. 7035 WITH TYPE M-2 GRATE AND T-4 BACK, OR APPROVED EQUAL.

** ALL PRE-CAST INLET BASINS SHALL MEET THE REQUIREMENTS OF O.D.O.T SPEC. 706.13 WITH $6\% \pm 2\%$ AIR VOID CONTENT IN THE CURED CONCRETE.

** ALL JOINTS BETWEEN PRECAST MODULES SHALL BE SEALED WITH BITUMINOUS JOINT MATERIAL.

TOP VIEW
(CASTING REMOVED)

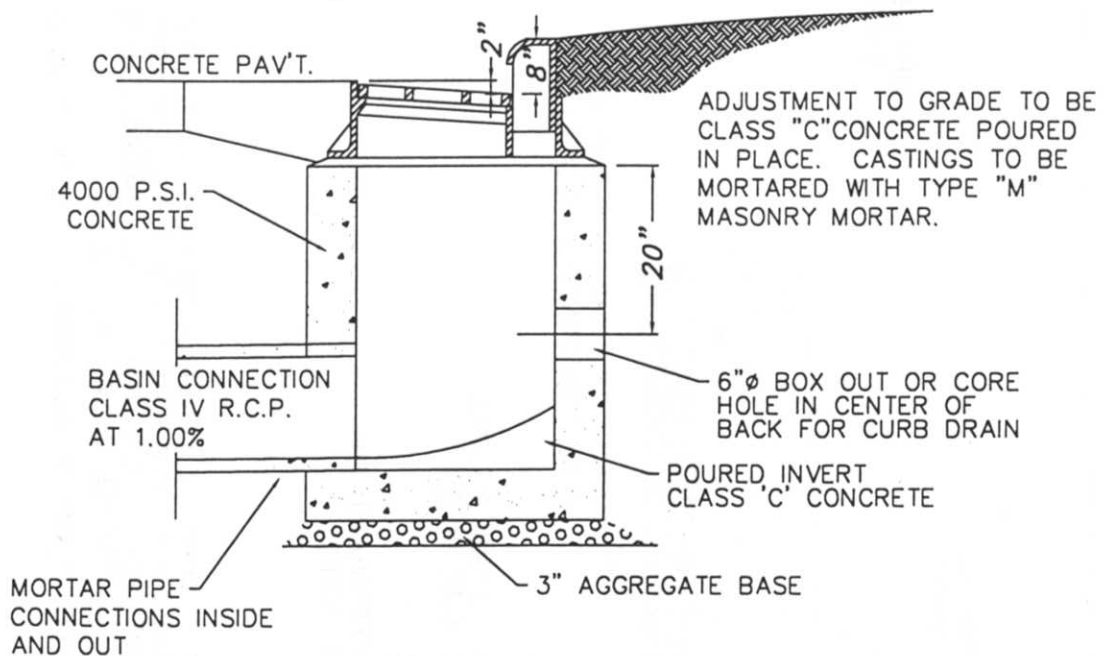

SECTION A-A

REINFORCED CONCRETE CURB INLET BASIN

