


FRAME AND GRATE SHALL BE EAST JORDAN IRON WORKS No. 7035 WITH TYPE M-2 GRATE AND T-4 BACK, OR APPROVED EQUAL.

** ALL PRE-CAST INLET BASINS SHALL MEET THE REQUIREMENTS OF O.D.O.T SPEC. 706.13 WITH $6\% \pm 2\%$ AIR VOID CONTENT IN THE CURED CONCRETE.

** ALL JOINTS BETWEEN PRECAST MODULES SHALL BE SEALED WITH BITUMINOUS JOINT MATERIAL.

TOP VIEW
(CASTING REMOVED)

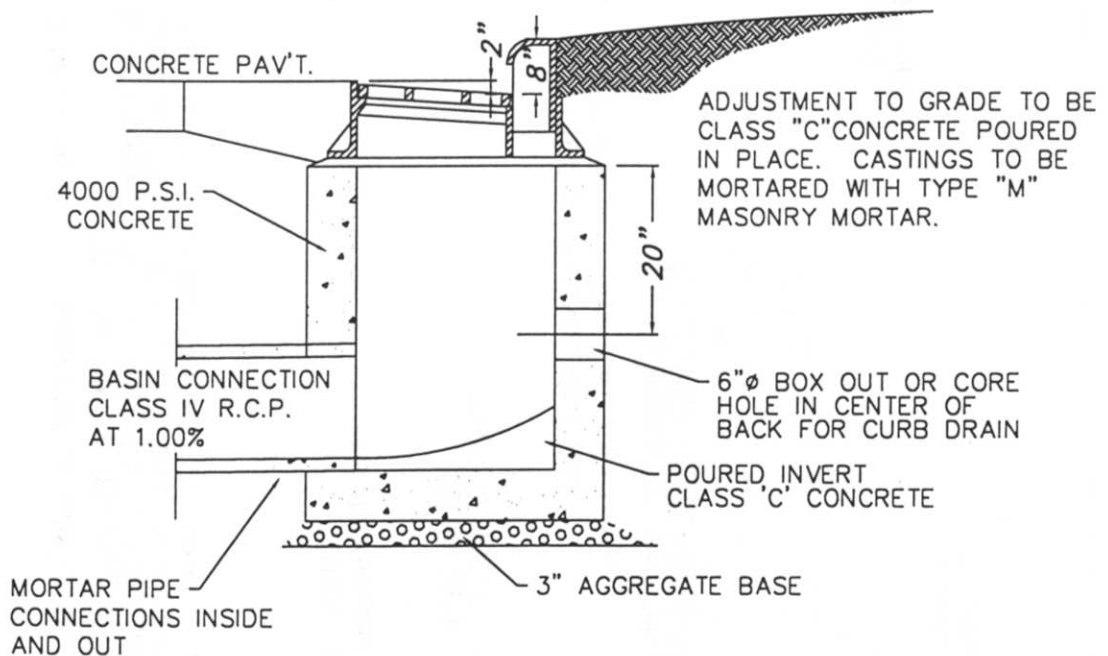

ADJUSTMENT TO GRADE TO BE CLASS "C" CONCRETE POURED IN PLACE. CASTINGS TO BE MORTARED WITH TYPE "M" MASONRY MORTAR.

SECTION A-A

REINFORCED CONCRETE CURB INLET BASIN

