



MINIMUM TRENCH WIDTH SHALL ALLOW FOR THOROUGH COMPACTION OF BEDDING AND BACKFILL MATERIAL

12" COMPACTED 304 LIMESTONE PREMIUM BACKFILL PLACED TO EXISTING GRADE AS PER ODOT SPEC. 603.08 & 603.081

No.57 LIMESTONE PREMIUM GRANULAR BEDDING AND/OR BACKFILL AS PER O.D.O.T. SPEC. 603.04 AND 603.08 FOR TRENCHES WITHIN THREE (3) FEET OF PAVEMENT

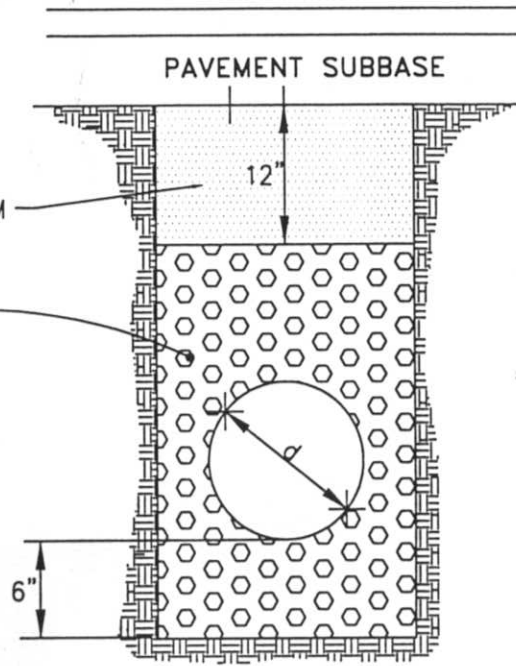

AREAS UNDER AND WITHIN THREE (3) FEET OF PAVEMENT

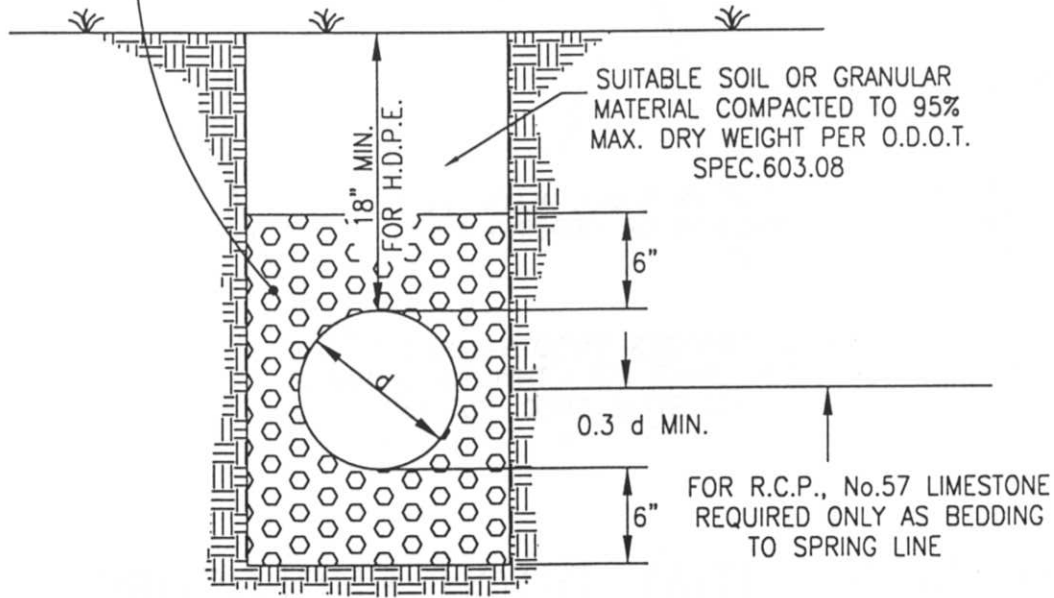

AREAS OUTSIDE PAVEMENT

# STORM SEWER TRENCH AND BACKFILL

